
35KV three-core intermediate connection

It is applicable to 26/35kv 3 cores PVC and XLPE power termination kit and intermediate joint, with good electrical and mechanical properties.

Model implication

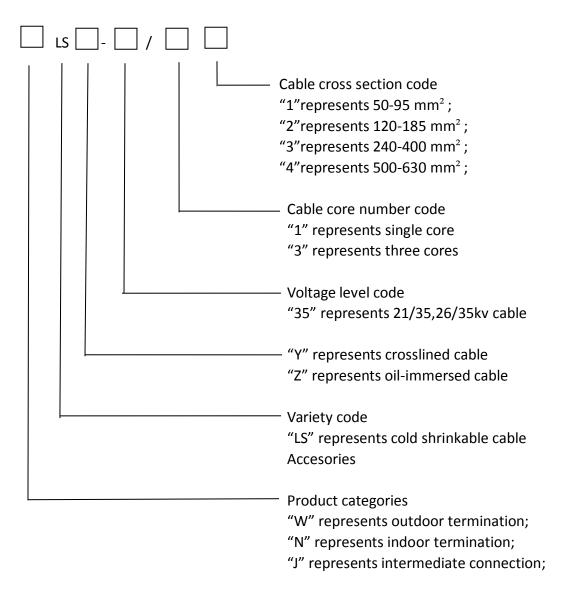

Technical Data

No.		Items	Requirements
1	DC withstand voltage test		156kv 15 min
2	Partial discharge test		≤10Pc (1.7U ₀)
3	Impulse voltage test		250kv 1.2/50 μs +10times
4	Power frequency withstand		
	vo	ltage test	78kv 4h
5	Humid condition power frequency withstand voltage test		
			105kv 1min
	(0	outdoor)	
6	Dry condition power frequency withstand voltage test (indoor)		
			105kv 1min
7		Shore hardness(A)	45 ± 3
8	Main cold	Tensile strength	
	shrinkable	(Mpa)	≥14
9	material	Permanent	
		distortion ratio	≤5%
10		Volume resistivity	
	Insulation	(Ω .cm)	≥1×10 ¹⁴
11	tubing	Breakdown	
		strength(kv/mm)	≥23
12	Heat		
	shrinkable	Dielectric	
	stress	constant(ε)	≈25
	control tube		

Product



Specification

Product Name		Model	Cable cross section(mm ²)
35KV	three-core	JLSY-35/3.1	50-95
intermediate		JLSY-35/3.2	120-185
connection		JLSY-35/3.3	240-400
		JLSY-35/3.4	500-630